

## Series DS-1 Dry-Type Sprinklers 5.6K Pendent, Upright, and Horizontal Sidewall **Quick Response, Standard Coverage**

#### **IMPORTANT**

Refer to Technical Data Sheet TFP2300 for warnings pertaining to regulatory and health information.

Always refer to Technical Data Sheet TFP700 for the "INSTALLER WARNING" that provides cautions with respect to handling and installation of sprinkler systems and components. Improper handling and installation can permanently damage a sprinkler system or its components and cause the sprinkler to fail to operate in a fire situation or cause it to operate prematurely.

Scan the QR code or enter the URL in a web browser to access the most up-to-date electronic version of this document. Data rates may apply.



docs.jci.com/tycofire/tfp510

### General **Description**

TYCO Series DS-1 Dry-Type Sprinklers, 5.6K Pendent, Upright, and Horizontal Sidewall, Quick Response (3 mm bulb) and Standard Coverage are decorative glass bulb automatic sprinklers designed for commercial use. Dry-type sprinklers are typically used where:

• Pendent sprinklers are required on dry pipe systems that are exposed to freezing temperatures; for example, sprinkler drops from unheated portions of buildings

- · Sprinklers and/or a portion of the connecting piping are exposed to freezing temperatures; for example, sprinkler drops from wet systems into freezers, sprinkler sprigs from wet systems into unheated attics, or horizontal piping extensions through a wall to protect an unheated areas such as loading docks, overhangs, and building exteriors
- · Sprinklers are used on systems that are seasonally drained to avoid freezing for example, vacation areas

#### NOTICE

The Series DS-1 Dry-Type Sprinklers described herein must be installed and maintained in compliance with this document, as well as with the applicable standards of the NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), in addition to the standards of any authorities having jurisdiction. Failure to do so may impair the performance of these devices.

The owner is responsible for maintaining their fire protection system and devices in proper operating condition. Contact the installing contractor or product manufacturer with any questions.

The Series DS-1 Dry-Type Sprinklers must only be installed in fittings that meet the requirements of the Design Criteria section.

## Sprinkler Identification **Numbers (SINs)**

3/4 in. NPT:

TY3935 - Pendent

TY3735 - Horizontal Sidewall

1 in. NPT:

TY3235 - Pendent TY3135 - Upright

TY3335 - Horizontal Sidewall





### **Technical** Data

**Approvals** 

UL and C-UL Listed


FM Approved


**EAC Approved** 

NYC Approved under MEA 352-01-E

Previous New York City Approval and MEA certification numbers apply to product as shown in this data sheet. In accordance with Section BC 3502 of the Construction Code, current NYC Approvals for use in the City of New York apply to all products that contain UL or FM Approvals and Listings; therefore, not all products currently Approved for use in the City of New York will carry an actual MEA Certification number.

For Approvals details, see Table A and Table B.

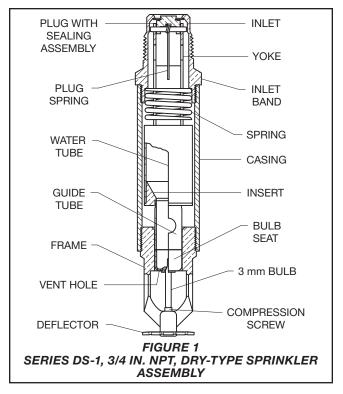

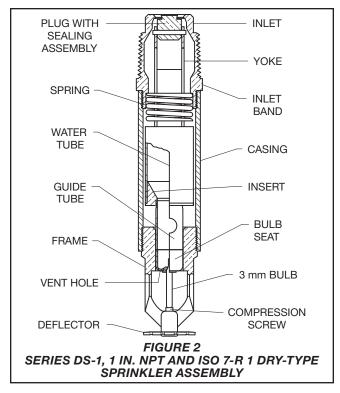

### Maximum Working Pressure

175 psi (12,1 bar)

## **Inlet Thread Connections** 3/4 in. NPT

1 in. NPT or ISO 7-R 1

## **Discharge Coefficient** K=5.6 gpm/psi<sup>1/2</sup> (80,6 Lpm/bar<sup>1/2</sup>)

## Temperature Ratings See Table A and Table B

#### **Finishes**

Sprinkler: Natural Brass, Chrome Plated, or Signal White

Escutcheon: Signal White, Chrome Plated, or Brass Plated

#### **Physical Characteristics**

i ilysicai Oliai acteristics
Inlet Copper
Plug Copper
Yoke Stainless Steel
Casing Galvanized Carbon Steel
Insert Bronze
Bulb Seat Stainless Steel
Bulb
Compression Screw Bronze
Deflector Bronze
FrameBronze
Guide Tube Stainless Steel
Water Tube Stainless Steel
Spring Stainless Steel
Plug Spring* Stainless Steel
Sealing Assembly Beryllium Nickel w/TEFLON
EscutcheonCarbon Steel or Stainless Steel

<sup>\*</sup> For 3/4 in. NPT only

### **Operation**

When the TYCO Series DS-1 Dry-Type Sprinklers, 5.6K Pendent, Upright, and Horizontal Sidewall, Quick Response (3 mm bulb) and Standard Coverage are in service, water is prevented from entering the assembly by the plug with sealing assembly in the inlet of the sprinkler. See Figure 1 and Figure 2.

The glass bulb contains a fluid that expands when exposed to heat. When the rated temperature is reached, the fluid expands sufficiently to shatter the glass bulb, and the bulb seat is released.

The compressed spring is then able to expand and push the water tube as well as the guide tube outward. This action simultaneously pulls inward on the yoke, withdrawing the plug with sealing assembly from the inlet and allowing the sprinkler to activate and flow water.

### Design Criteria

The TYCO Series DS-1 Dry-Type Sprinklers, 5.6K Pendent, Upright, and Horizontal Sidewall, Quick Response (3 mm bulb) and Standard Coverage are intended for use in fire sprinkler systems designed in accordance with the standard installation rules recognized by the applicable Listing or Approval agency; for example, UL Listing is based on NFPA 13 requirements.

#### **Sprinkler Fittings**

Install the 3/4 or 1 in. NPT Series DS-1 Dry-Type Sprinklers in the 3/4 or 1 in. NPT outlet or run of the following fittings:

- Malleable or ductile iron threaded tee fittings that meet the dimensional requirements of ANSI B16.3 (Class 150)
- Cast iron threaded tee fittings that meet the dimensional requirements of ANSI B16.4 (Class 125)

Do not install the DS-1 Sprinklers into an elbow fittings. The inlet of the sprinkler can contact the interior of the elbow, potentially damaging the Inlet seal.

The unused outlet of the threaded tee is plugged as shown in Figure 13.

You can also install the Series DS-1 Dry-Type Sprinklers in the 3/4 or 1 in. NPT outlet of a GRINNELL Figure 730 Mechanical Tee. However, the use of the Figure 730 Tee for this arrangement is limited to wet pipe systems.

The configuration shown in Figure 12 is only applicable for wet pipe systems where the sprinkler fitting and water-filled pipe above the sprinkler fitting are not subject to freezing and where the length of the dry-type sprinkler has the minimum exposure length depicted in Figure 11. See the Exposure Length section.

For wet pipe system installations of the 1 in. NPT Series DS-1 Dry-Type Sprin-

		3/4 in. NPT								
		TY3935 Pendent with Recessed Escutcheon (Figure 4)			TY3935 Pendent with Standard Escutcheon (Figure 3)		TY3735 Horizontal Sidewall with Top of Deflector-to-Ceiling Distance of 4 to 12 in. (100 to 300 mm)			
			with Deep Escutcheon (Figure 5)		with Standard Escutcheon (Figure 8)		ıtcheon			
					with	out Escutch (Figure 6)	neon	with I	Deep Escuto (Figure 9)	heon
								with	out Escutch (Figure 10)	eon
Temperature	Bulb	Finish								
Rating	Color Code	Natural Brass	Chrome Plated	White Polyester	Natural Brass	Chrome Plated	White Polyester	Natural Brass	Chrome Plated	White Polyester
135°F (57°C)	Orange									
155°F (68°C)	Red									
175°F (79°C) Yellow		1, 2			1, 2		1*, 2*			
200°F (93°C)	Green									
286°F (141°C)	Blue									

#### NOTES

- Listed by Underwriters Laboratories, Inc. (maximum order length of 48 in.)
   Listed by Underwriters Laboratories for use in Canada (maximum order length of 48 in.)

Light and Ordinary Hazard occupancies only

TABLE A 3/4 IN. NPT SERIES DS-1 QUICK RESPONSE, STANDARD COVERAGE DRY-TYPE SPRINKLERS LABORATORY LISTINGS AND APPROVALS

		1 in. NPT (and ISO 7-R 1)								
		TY3235 Pendent		TY3235 Pendent		TY3335 Horizontal Sidewall with Top of Deflector-to-Ceiling				
		with Recessed Escutcheon (Figure 4)		with Standard Escutcheon (Figure 3)		Distance of 4 to 12 in. (100 to 300 mm)		12 in.		
				with Deep Escutcheon (Figure 5)		with Standard Escutcheon (Figure 8)		utcheon		
					without Escutcheon (Figure 6)		with Deep Escutcheon (Figure 9)		cheon	
				TY3135 Upright without Escutcheon <sup>5</sup> (Figure 7)		without Escutcheon (Figure 10)		neon		
Temperature	Bulb					Finish				
Rating	Color Code	Natural Brass	Chrome Plated	White Polyester	Natural Brass	Chrome Plated	White Polyester	Natural Brass	Chrome Plated	White Polyester
135°F (57°C)	Orange									
155°F (68°C)	Red	100	2 1 6	1046						
175°F (79°C)	Yellow	1, 2, 3, 4, 6		1, 2, 4, 6	1, 2, 3, 4,	, 4, 6	1, 2, 4, 6	1*, 2*, 3** <b>,</b> 4, 6		1*, 2* <b>,</b> 4, 6
200°F (93°C)	Green									
286°F (141°C)	Blue	·	1, 2, 4, 6							
NOTES										

- 1. Listed by Underwriters Laboratories, Inc. (maximum order length of 48 in.)
  - 5. The Upright Sprinkler without an Escutcheon (TY3135) is available in 1 in. NPT only
- Listed by Underwriters Laboratories for use in Canada (maximum order length of 48 in.)
   Approved by Factory Mutual Research Corporation (maximum order length of48 in.)
   Light and Ordin Light Hazard occupancies only

4. Approved by the City of New York under MEA 352-01-E

Light and Ordinary Hazard occupancies only

#### TABLE B 1 IN. NPT (AND ISO 7-R 1) SERIES DS-1 QUICK RESPONSE, STANDARD COVERAGE DRY-TYPE SPRINKLERS LABORATORY LISTINGS AND APPROVALS

klers connected to CPVC piping, use only the following TYCO CPVC fittings:

- 1 in. x 1 in. NPT female adapter (P/N
- 1 in. x 1 in. x 1 in. NPT sprinkler head adapter tee (P/N 80249)


For wet pipe system installations of the the 3/4 in. NPT Series DS-1 Sprinklers connected to CPVC piping, use in the 3/4 in. x 3/4 in. NPT female adapter (P/N 80142).

For dry pipe system installations, use only the side outlet of maximum 2 1/2 in. reducing tee when locating the Series DS-1 Sprinklers directly below the branch line. Otherwise, use the configuration shown in Figure 13 to assure complete water drainage from above the Series DS-1 Dry-Type Sprinklers and the branch line. Failure to do so may result in pipe freezing and water damage.

#### NOTICE

Do not install the Series DS-1 Dry-Type Sprinkler into any other type fitting. Failure to use the appropriate fitting may result in one of the following:

- Failure of the sprinkler to operate properly due to formation of ice over the inlet plug or binding of the inlet plug
- Insufficient engagement of the Inlet pipe threads with consequent leakage

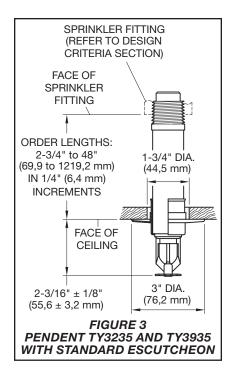

#### **Drainage**

In accordance with the minimum requirements of the NATIONAL FIRE PROTECTION ASSOCIATION for dry pipe sprinkler systems, branch, cross, and feed-main piping connected to dry sprinklers and subject to freezing temperatures must be pitched for proper drainage.


#### **Exposure Length**


When using dry sprinklers in wet pipe sprinkler systems to protect areas subject to freezing temperatures, use Table C to determine a sprinkler's appropriate exposed barrel length to prevent water from freezing in the connecting pipes due to conduction. The exposed barrel length measurement must be taken from the face of the sprinkler fitting to the surface of the structure or insulation that is exposed to the heated area. For example, see Figure 11.

#### **Clearance Space**

In accordance with NFPA 13, when connecting an area subject to freezing and an area containing a wet pipe sprinkler system, the clearance space around the sprinkler barrel of dry-type sprinklers must be sealed. Due to temperature differences between two areas, the potential for the formation of condensation in the sprinkler and subsequent ice build-up is increased. If this condensation is not controlled, ice build-up can occur that might damage the dry-type sprinkler and/or prevent proper operation in a fire situation.

Model DSB-2 Dry Sprinkler Boot (Technical Data Sheet TFP591), as shown in Figure 14 and Figure 15, can provide the recommended seal.

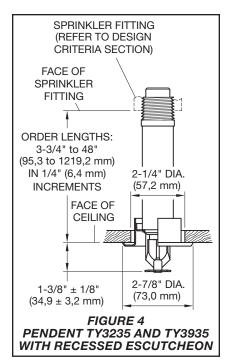

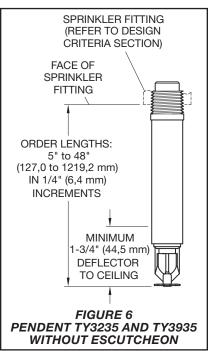



### Installation

The TYCO Series DS-1 Dry-Type Sprinklers, 5.6K Pendent, Upright, and Horizontal Sidewall, Quick Response (3 mm bulb) and Standard Coverage must be installed in accordance with this section.

#### **General Instructions**

The Series DS-1 Dry-Type Sprinklers must only be installed in fittings that meet the requirements of the Design Criteria section. See the Design Criteria section for other important require-

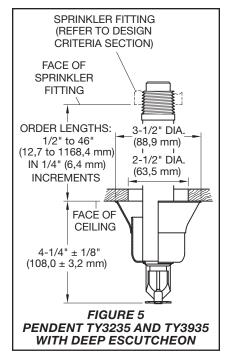


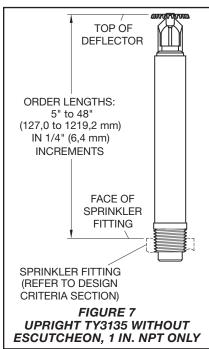



ments regarding piping design and sealing of the clearance space around the sprinkler casing.

Do not install any bulb-type sprinkler if the bulb is cracked or there is a loss of liquid from the bulb. With the sprinkler held horizontally, a small air bubble should be present. The diameter of the air bubble is approximately 1/16 in. (1,6 mm) for the 135°F (57°C) rating to 1/8 in. (3,2 mm) for the 286°F (141°C) rating.

 A leak-tight 3/4 in. NPT sprinkler joint should be obtained by applying

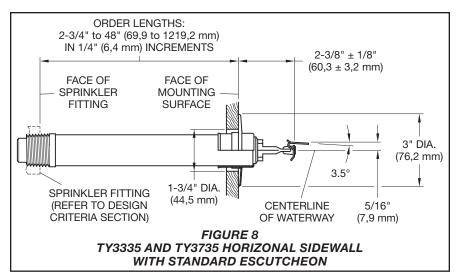

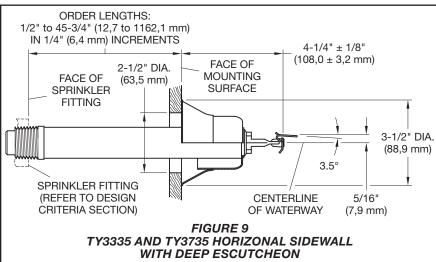

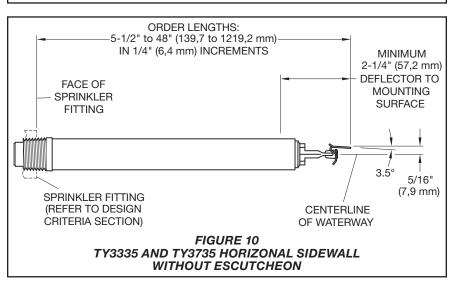

a minimum-to-maximum torque of 10 ft-lb to 20 ft-lb (13,4 N·m to 26,8 N·m).

 A leak-tight 1 in. NPT sprinkler joint should be obtained by applying a minimum-to-maximum torque of 20 ft-lb to 30 ft-lb (26,8 N·m to 40,2 N·m).

Higher levels of torque can distort the sprinkler Inlet with consequent leakage or impairment of the sprinkler.

Do not attempt to compensate for insufficient adjustment in an escutcheon plate by under or over-tightening the sprinkler. Re-adjust the position of the sprinkler fitting to suit.

**Step 1.** Install pendent sprinklers only in the pendent position, and install upright sprinklers only in the upright position. The deflector of a pendent or upright sprinkler must be parallel to the ceiling.

Install horizontal sidewall sprinklers in the horizontal position with their centerline of waterway perpendicular to the back wall and parallel to the ceiling. Ensure the word "TOP" on the deflector faces the ceiling.

**Step 2.** With a non-hardening pipethread sealant such as TEFLON tape applied to the inlet threads, hand-tighten the sprinkler into the sprinkler fitting.

**Step 3.** Wrench-tighten the sprinkler using either of the following tools:

- Pipe wrench on the inlet band or the casing, see Figures 1 and 2
- W-Type 7 Sprinkler Wrench on the wrench flat, see Figure 16

Apply the wrench recess of the W-Type 7 Sprinkler Wrench to the wrench flat.

**Note:** If sprinkler removal becomes necessary, remove the sprinkler using the same wrenching method noted above. Sprinkler removal is easier when a non-hardening sealant was used and torque guidelines were followed. After removal, inspect the sprinkler for damage.

**Step 4.** After installing the ceiling or wall and applying a ceiling finish, slide on the outer piece of the escutcheon until it comes in contact with the ceiling or wall. Do not lift the ceiling panel out of its normal position.

When using the deep escutcheon, hold the outer piece in contact with the mounting surface (ceiling or wall). Then rotate the inner piece approximately 1/4 turn with respect to the outer piece, to hold the deep escutcheon firmly together.


## **TFP510** Page 6 of 8


Ambient		perature ated Are			
Temperature Exposed to	40°F	50°F	60°F		
	(4°C)	(10°C)	(16°C)		
Discharge End of Sprinkler	Minimum Exposed Barrel Length <sup>(2)</sup> , in. (mm)				
40°F (4°C)	0	0	0		
30°F (-1°C)	0	0	0		
20°F (-7°C)	4 (100)	0	0		
10°F	8	1	0		
(-12°C)	(200)	(25)			
0°F	12	3	0		
(-18°C)	(305)	(75)			
-10°F	14	4	1		
(-23°C)	(355)	(100)	(25)		
-20°F	14	6	3		
(-29°C)	(355)	(150)	(75)		
-30°F	16	8	4		
(-34°C)	(405)	(200)	(100)		
-40°F	18	8	4		
(-40°C)	(455)	(200)	(100)		
-50°F	20	10	6		
(-46°C)	(510)	(255)	(150)		
-60°F	20	10	6		
(-51°C)	(510)	(255)	(150)		


#### Notes:


- For protected area temperatures that occur between values listed above, use the next cooler temperature.
- These lengths are inclusive of wind velocities up to 30 mph (18,6 kph).

TABLE C
EXPOSED SPRINKLER BARRELS
IN WET PIPE SYSTEMS
MINIMUM RECOMMENDED
LENGTHS

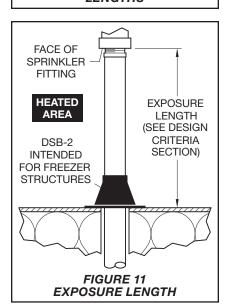


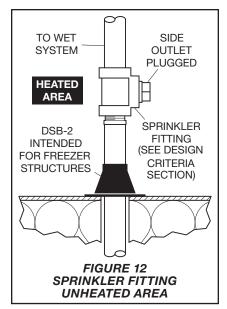


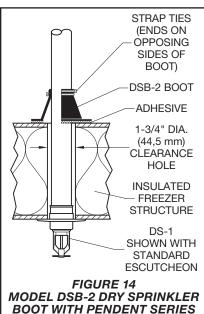



**DS-1 DRY-TYPE SPRINKLER** 

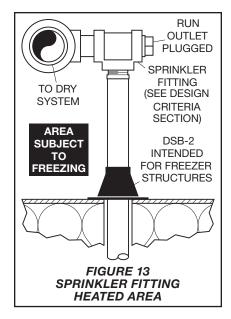

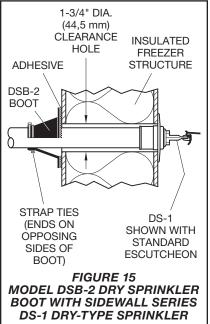

## Care and Maintenance

The TYCO Series DS-1 Dry-Type Sprinklers, 5.6K Pendent, Upright, and Horizontal Sidewall, Quick Response (3 mm bulb) and Standard Coverage must be maintained and serviced in accordance with this section.

Before closing a fire protection system main control valve for maintenance work on the fire protection system that it controls, obtain permission to shut down the affected fire protection systems from the proper authorities and notify all personnel who may be affected by this action.

Absence of the outer piece of an escutcheon, which is used to cover a clearance hole, can delay the time to sprinkler operation in a fire situation.

A vent hole is provided in the bulb seat (see Figures 1 and 2) to indicate if the dry-type sprinkler is remaining dry. Evidence of leakage from the vent hole indicates potential leakage past the lnlet seal and the need to remove the sprinkler to determine the cause of leakage for example, an improper installation or an ice plug. Close the fire protection system control valve and drain the system before removing the sprinkler.

Sprinklers which are found to be leaking or exhibiting visible signs of corrosion must be replaced.

Automatic sprinklers must never be painted, plated, coated, or otherwise altered after leaving the factory. Modified sprinklers must be replaced. Sprinklers that have been exposed to corrosive products of combustion, but have not operated, should be replaced if they cannot be completely cleaned by wiping the sprinkler with a cloth or by brushing it with a soft bristle brush.

Care must be exercised to avoid damage to the sprinklers before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced. Also, replace any sprinkler that has a cracked bulb or that has lost liquid from its bulb. See the Installation Section.

The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in compliance with this document, as well as with the applicable standards of the NATIONAL FIRE PROTECTION ASSOCIATION such as NFPA 25, in addition to the standards of any other authorities having jurisdiction. Contact the installing contractor or product manufacturer with any questions.

Automatic sprinkler systems are recommended to be inspected, tested, and maintained by a qualified Inspection Service in accordance with local requirements and/or national codes.

## Limited Warranty

For warranty terms and conditions, visit www.tyco-fire.com.

## Ordering Procedure

Contact your local distributor for availability. When placing an order, indicate the full product name and Part Number (P/N).

**DS-1 Dry-Type Sprinklers** 

When ordering TYCO Series DS-1 Dry-Type Sprinklers, 5.6K Pendent, Upright, and Horizontal Sidewall, Quick Response (3 mm bulb) and Standard Coverage, specify the following information:

- SIN:
  - Pendent TY3935 or TY3235 Sidewall – TY3735 or TY3335 Upright – TY3135
- 5.6 K-factor
- Deflector style: Upright, Pendent, or Horizontal Sidewall
- Quick Response, Standard Coverage, Dry-Type Sprinkler
- Order length:

Dry-Type Sprinklers are furnished based upon order length as measured acording to Figures 3 through 10. After taking the measurement, round it to the nearest 1/4 in. increment.

- Inlet connections:
   3/4 in. NPT, 1 in. NPT, or ISO 7-R 1
- · Temperature rating
- Sprinkler finish
- Escutcheon style and finish, as applicable
- Part Number (P/N) from Table D

The upright sprinkler without an escutcheon (TY3135) is available in 1 in. NPT only.

Part Numbers are for 3/4 in. and 1 in. NPT standard order sprinklers. Orders for all other sprinkler assemblies must be accompanied by a complete description. Refer to the price list for a complete listing of part numbers.

#### **Replacement Escutcheons**

Order replacement escutcheons separately.

**Note:** Style 10 recessed escutcheons are shipped as assemblies comprised of closure ring and mounting plate. The included mounting plate is not used for dry type sprinkler applications, discard accordingly.

Specify: (specify type), (specify) finish, P/N (specify):

## Recessed (Style 10) Brass Plated 56-701-2-010 Signal White (RAL9003) 56-701-4-010 Chrome Plated 56-701-9-010

 Standard (Push-On)

 White Color
 91-106-0-007

 Brass Plated
 91-106-2-007

 Chrome Plated
 91-106-9-007

## Deep Brass Plated 91-107-2-010 White 91-107-4-007 Chrome Plated 91-107-9-007

#### Sprinkler Wrench

Specify: W-Type 7 Sprinkler Wrench, P/N 56-850-4-001

#### Sprinkler Boot

Specify: Model DSB-2 Dry Sprinkler Boot, P/N 63-000-0-002

This part number includes one (1) boot, two (2) strap ties, and 1/3 oz of adhesive (a sufficient quantity for installing one boot).

## P/N\*60-XXX-X-XXX

		SIN
01	Pendent with Standard Escutcheon (3/4 in. NPT)	TY3935 (Figure 3)
02	Pendent with Deep Escutcheon (3/4 in. NPT)	TY3935 (Figure 5)
03	Pendent with Recessed Escutcheon (3/4 in. NPT)	TY3935 (Figure 4)
04	Pendent without Escutcheon (3/4 in. NPT)	TY3935 (Figure 6)
05	Sidewall with Standard Escutcheon (3/4 in. NPT)	TY3735 (Figure 8)
06	Sidewall with Deep Escutcheon (3/4 in. NPT)	TY3735 (Figure 9)
07	Sidewall without Escutcheon (3/4 in. NPT)	TY3735 (Figure 10)
36	Pendent with Standard Escutcheon (1 in. NPT)	TY3235 (Figure 3)
33	Pendent with Deep Escutcheon (1 in. NPT)	TY3235 (Figure 5)
37	Pendent with Recessed Escutcheon (1 in. NPT)	TY3235 (Figure 4)
32	Pendent without Escutcheon (1 in. NPT)	TY3235 (Figure 6)
34	Sidewall with Standard Escutcheon (1 in. NPT)	TY3335 (Figure 8)
43	Sidewall with Deep Escutcheon (1 in. NPT)	TY3335 (Figure 9)
44	Sidewall without Escutcheon (1 in. NPT)	TY3335 (Figure 10)
38	Upright without Escutcheon (1 in. NPT)	TY3135 (Figure 7)

	Sprinkler Finish	Escutcheon Finish¹
0 Chrome Plated		Signal White (RAL9003) Polyester
1	Natural Brass	Signal White (RAL9003) Polyester
2	Natural Brass	Brass Plated
4	Signal White (RAL9003) Polyester	Signal White (RAL9003) Polyester
8	Chrome Plated	Stainless Steel
9	Chrome Plated	Chrome Plated

	Sample Order Length <sup>2</sup>
055	5.50 in.
082	8.25 in.
180	18.00 in.
187	18.75 in.
372	37.25 in.
480	48.00 in.

	- 1	
		Temperature Rating
	0	135°F (57°C)
	1	155°F (68°C)
Ī	2	175°F (79°C)

	Temperature Rating
3	200°F (93°C)
4	286°F (141°C)

#### NOTES

- Escutcheon Finish applies to sprinklers provided with escutcheons.
   Dry-Type Sprinklers are furnished based upon "Order Length" as measured per Figures 3 through 10, as applicable, and for each individual sprinkler where it is to be installed. After the measurement is taken, round it to the
- nearest 1/4 in. increment.

  \* Use Prefix "I" for ISO 7-R 1 Connection (for example, I-60-360-4-055).

TABLE D **SERIES DS-1 DRY-TYPE SPRINKLERS** PART NUMBER SELECTION





# **TFP510 Change History Appendix**

ISSUE DATE	NOTES
08-22	Page 1, updated QR code and URL; Page 8, changed corporate address and telephone number to 1467 Elmwood Avenue, Cranston, RI 02910   Telephone +1-401-781-8220, formerly 1400 Pennbrook Parkway, Lansdale, PA 19446   Telephone +1-215-362-0700.
04-22	Page 1, added QR code and URL to allow convenient access to electronic version from printed document; Page 1, Approvals sub-section, and Page 3, Table B added EAC Approved for TY3135, TY3235 and TY3335 only; Reduced to 8 pages, formerly 10.
09-21	Added Replacement Escutcheons to Ordering Procedure.
11-19	Removed consulting Technical Services Department statement from Sprinkler Fittings subsection Notice.
03-19	Added chrome plated sprinkler with stainless steel escutcheon finish option.
08-18	Updated Tyco® branding and document format; Added Johnson Controls copyright; Added disclaimer stating specifications and information subject to change without notice; Added reference to Regulatory and Health Warning Technical Data Sheet TFP2300.
06-15	Changed Standard Recessed Escutcheon to Recessed Escutcheon.
09-14	Removed note from Table D Part Number Selection limiting sprinklers having 286°F (141°C) Temperature Rating to non-recessed assemblies only.
06-13	Updated and standardized RAL color finishes; Clarified method for measuring proper HSW sprinkler with escutcheon installations, now indicating distance from mounting surface to face of deflector, formerly to end of deflector.
05-11	Clarified NYC Approved; Updated minimum order and exposed barrel lengths; Improved Design Criteria section; Updated patent information.
04-11	Updated patent information.
10-10	Added 3/4 in. NPT Inlet for Pendent and Horizontal Sidewall models; Clarified Design Criteria, Installation, and Care and Maintenance sections.
01-08	Corrected part number for Natural Brass sprinkler with Brass plate escutcheon finish option; Increased minimum order length for HSW sprinklers w/o escutcheon to 5-1/2 in. (139,7 mm), formerly 5 in. (127,0 mm).
12-07	Added Model DSB-2 Dry Sprinkler Boot; Added NFPA 13 requirements for use of DSB-2; Added illustrations providing guidance on alternative piping connections to dry type sprinklers for freeze protection or system drainage; Added Natural Brass sprinkler with Brass plate escutcheon finish option.
04-04	Added reference to Installer Warning data sheet TFP700; Added no escutcheon option for pendent and horizontal dry type sprinklers; Added deep escutcheon option for horizontal dry type sprinklers; Added guidance on use of compatible CPVC fittings.
01-03	Added new Tyco Fire & Building Products masthead; Removed 3/4 in. NPT and 1-1/4 in. UNS thread options.
02-02	New Technical Data Sheet TFP510 describes Series DS-1, Standard Coverage Dry Type Quick Response Sprinklers.

